

4


3

2

1

B

B

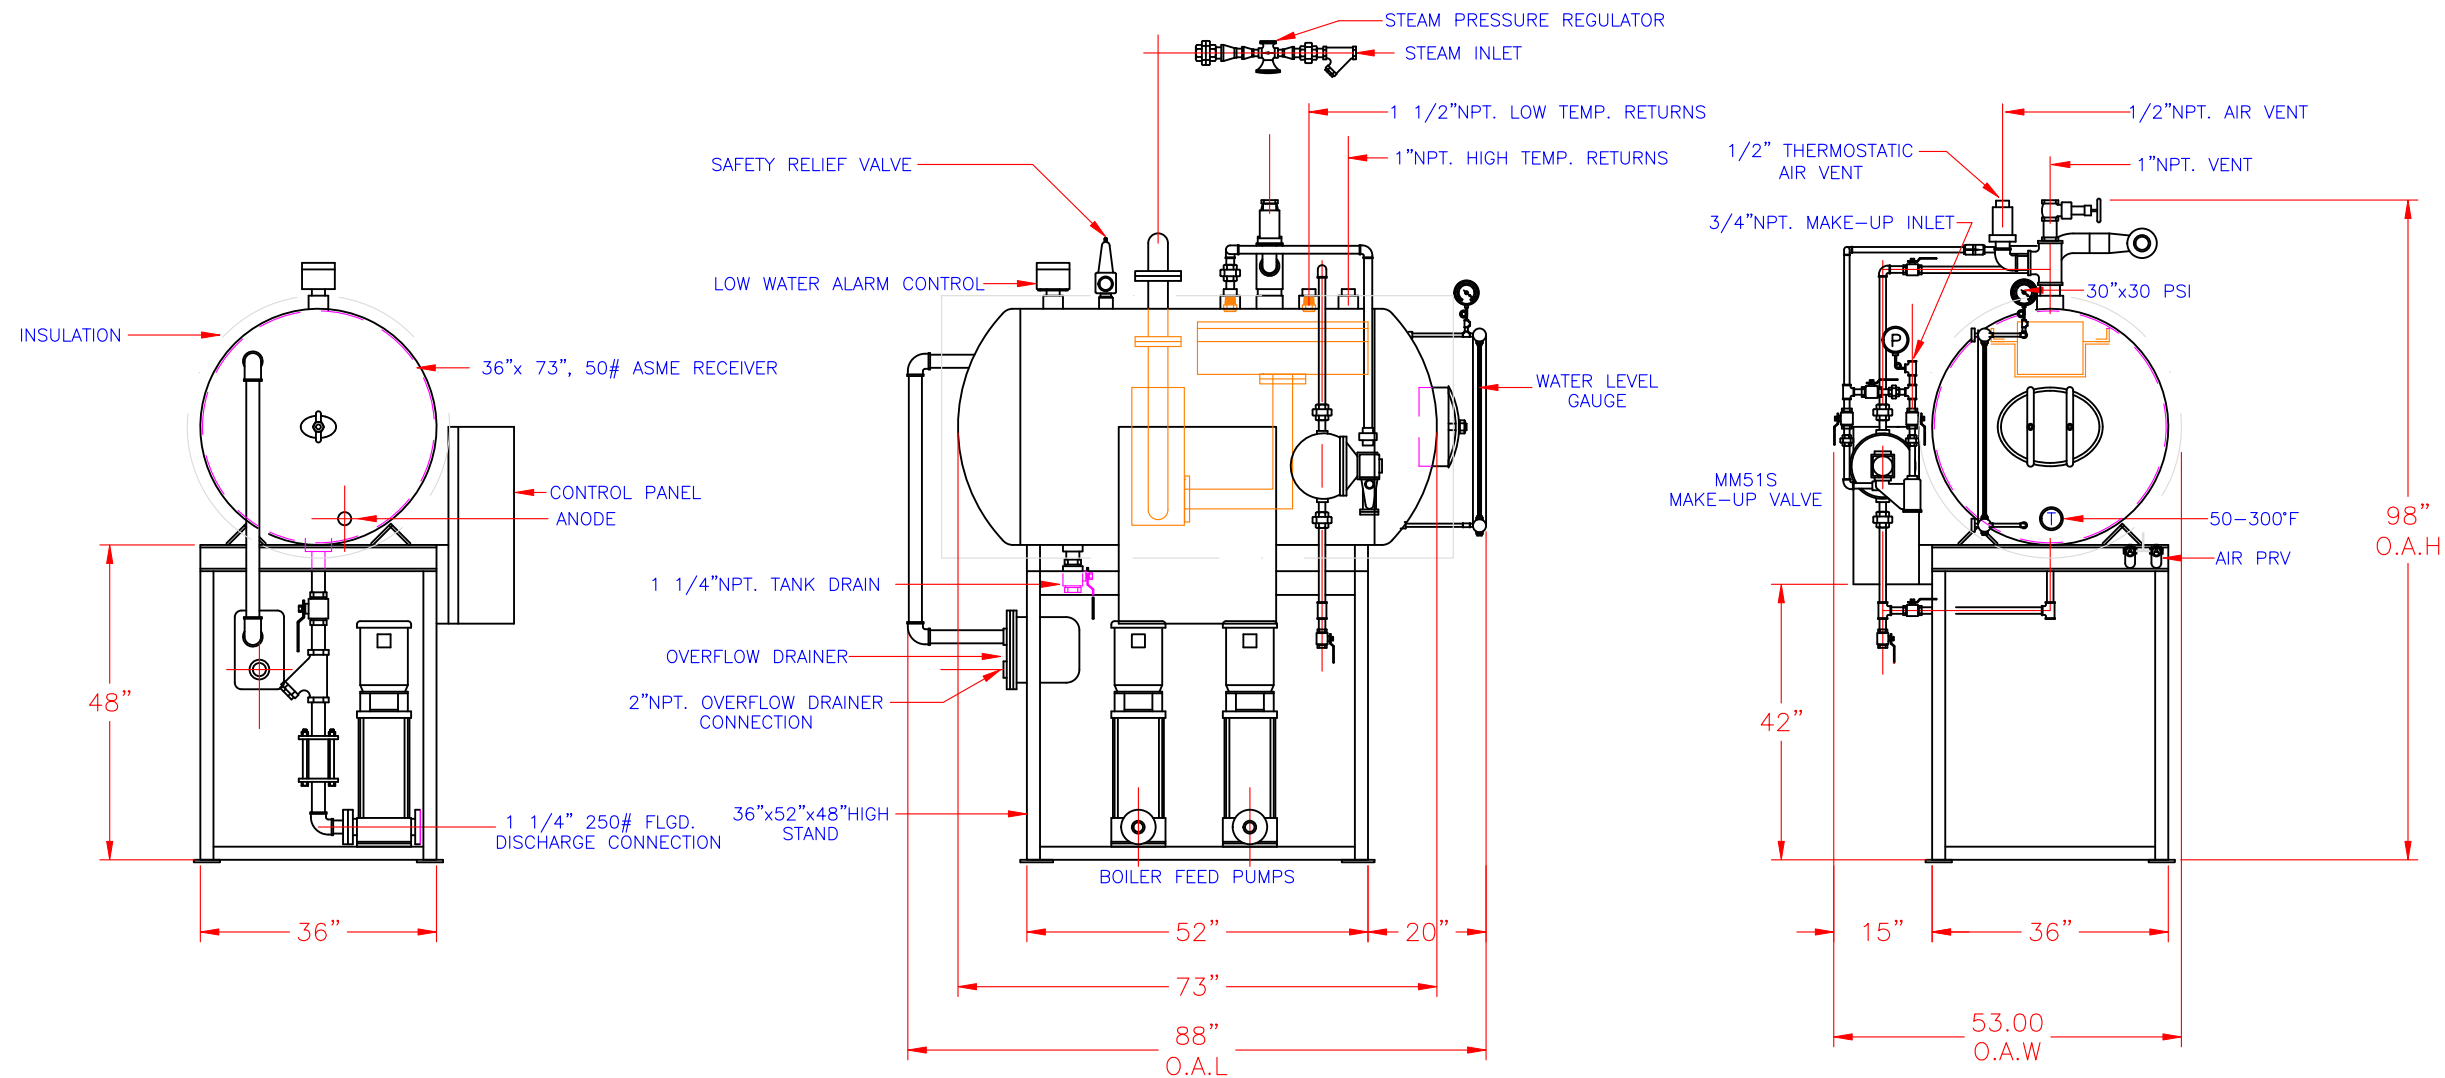

PUMP SIZE, CONFIGURATION AND STAND HEIGHT DEPENDS ON ENGINEERING SPECIFICATIONS.
 TANK, STAND AND COMPONENTS ARE ON LAYER 1
 INTERNAL COMPONENTS ARE ON LAYER 2
 DIMENSIONS ARE ON LAYER 4
 VERBAGE IS ON LAYER 5
 CENTERLINES ARE ON LAYER 8

A

A

4

3

2

1

	918 West Walnut Street Danville, KY 40422 Phone: (859) 236-3181 FAX: (859) 236-3184				TEMPLATE LAYOUT P5-250 PRESSURIZED DEAERATOR		
	Proprietary Information These drawings and/or specifications are the property of Sellers MFG Co. They are issued in strict confidence and shall not be reproduced, copied, or used as the basis for manufacture or sale without permission of the owner.		REV.	DATE			DESCRIPTION OF CHANGE
WEIGHT	lbs	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES		SCALE:		DRAWN BY: RMc	DATE: 12/2/19
MATERIAL		TOLERANCES: FRACTIONAL ± 1/32 XXX ± .015 XXX ± .005 ANGLES ± 1 DEG DO NOT SCALE DRAWING		DWG. SIZE: B		APPR. BY:	DATE:
FINISH				SHEET: 1 OF 1		DRAWING NUMBER: P5-0250	REV