

4


3

2

1

B

B

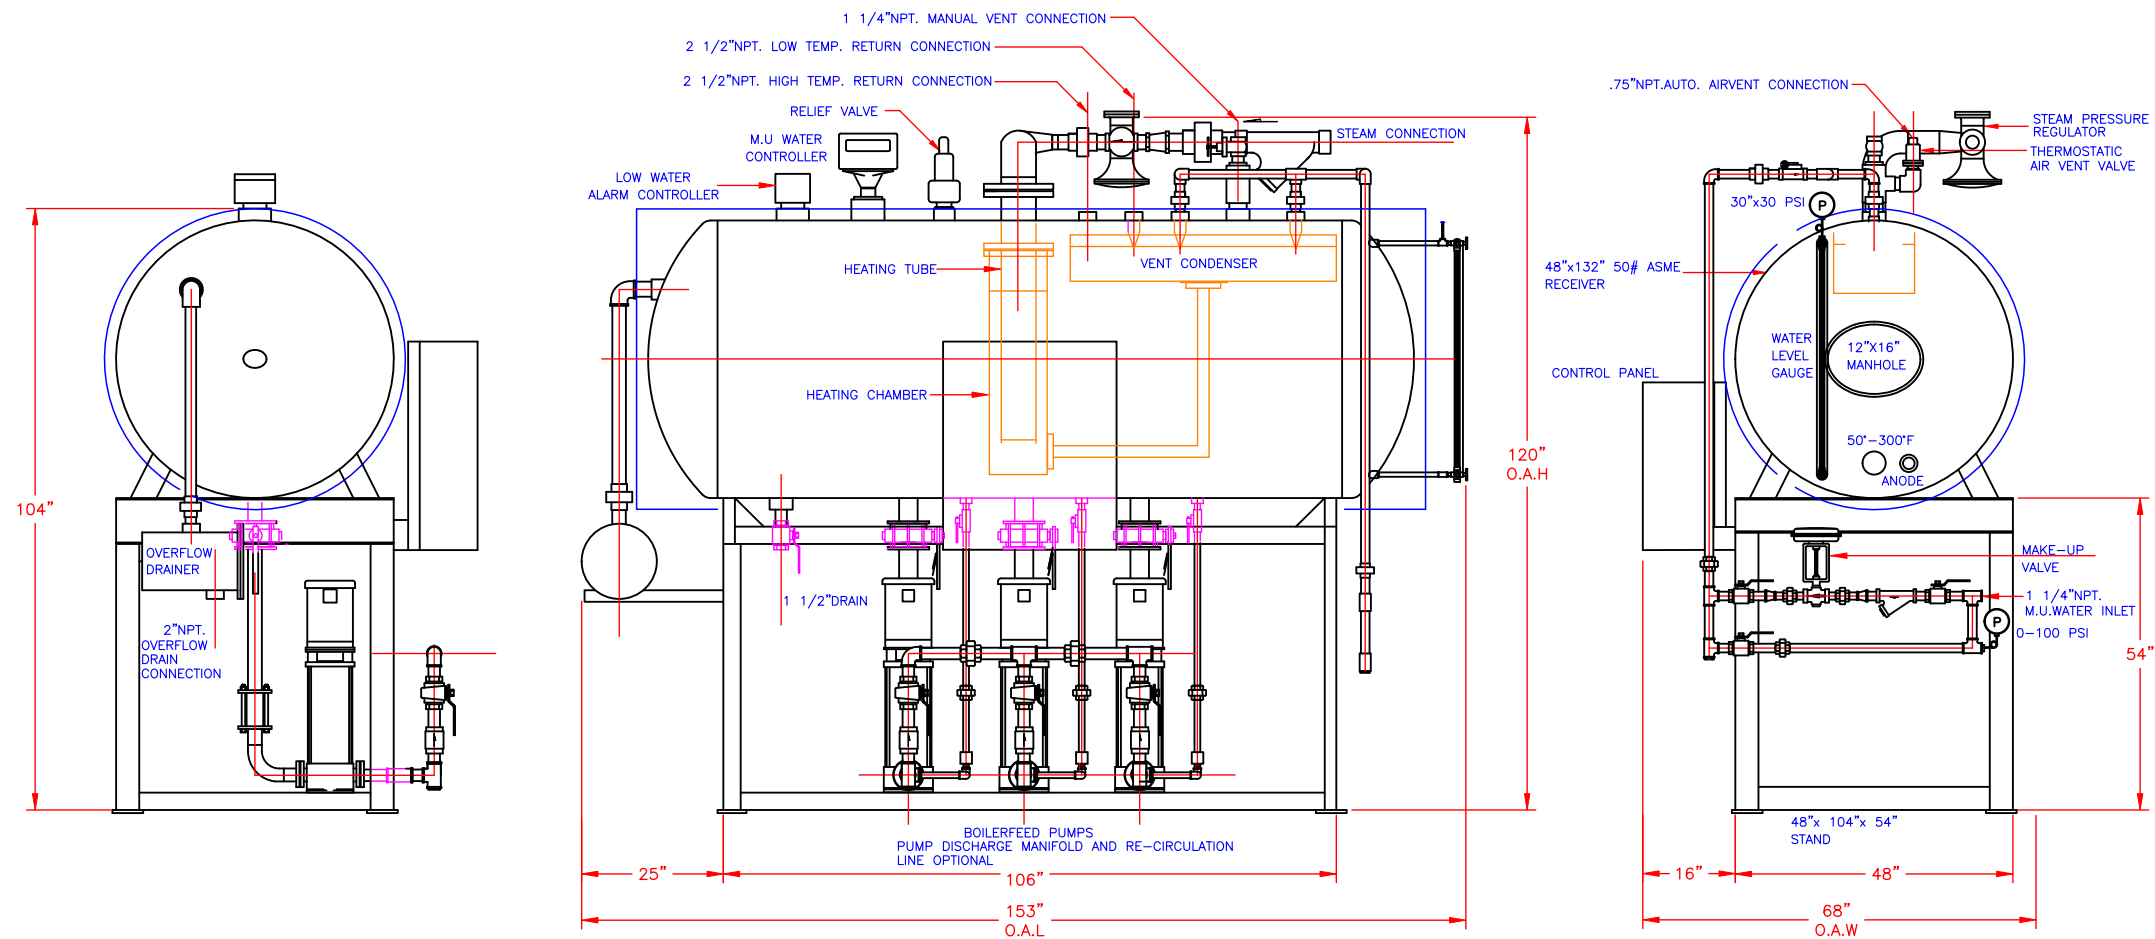

STAND HEIGHT COULD VARY DEPENDING UPON PUMP SIZE  
 PUMP DISCHARGE PIPING AND INSULATION ARE OPTIONAL

PUMP SIZE, CONFIGURATION AND STAND HEIGHT DEPENDS ON ENGINEERING SPECIFICATIONS.  
 TANK, STAND AND COMPONENTS ARE ON LAYER 1  
 INTERNAL COMPONENTS ARE ON LAYER 2  
 DIMENSIONS ARE ON LAYER 4  
 VERBAGE IS ON LAYER 5  
 CENTERLINES ARE ON LAYER 8

A

A

	918 West Walnut Street Danville, KY 40422 Phone: (859) 236-3181 FAX: (859) 236-3184						<b>TEMPLATE LAYOUT P5-1000          PRESSURIZED DEAERATOR</b>	
	Proprietary Information These drawings and/or specifications are the property of Sellers MFG Co. They are issued in strict confidence and shall not be reproduced, copied, or used as the basis for manufacture or sale without permission of the owner.		REV. DATE DESCRIPTION OF CHANGE DRAWN APPROVED			SCALE: DWG. SIZE: B SHEET: 1 OF 1 DRAWING NUMBER: P5-1000		DATE: 12/5/19 APPR. BY: RMc REV
WEIGHT 165 MATERIAL FINISH		UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONAL ± 1/32 XXX ± .015 XXXX ± .005 ANGLES ± 1 DEG DO NOT SCALE DRAWING						

4

3

2

1